



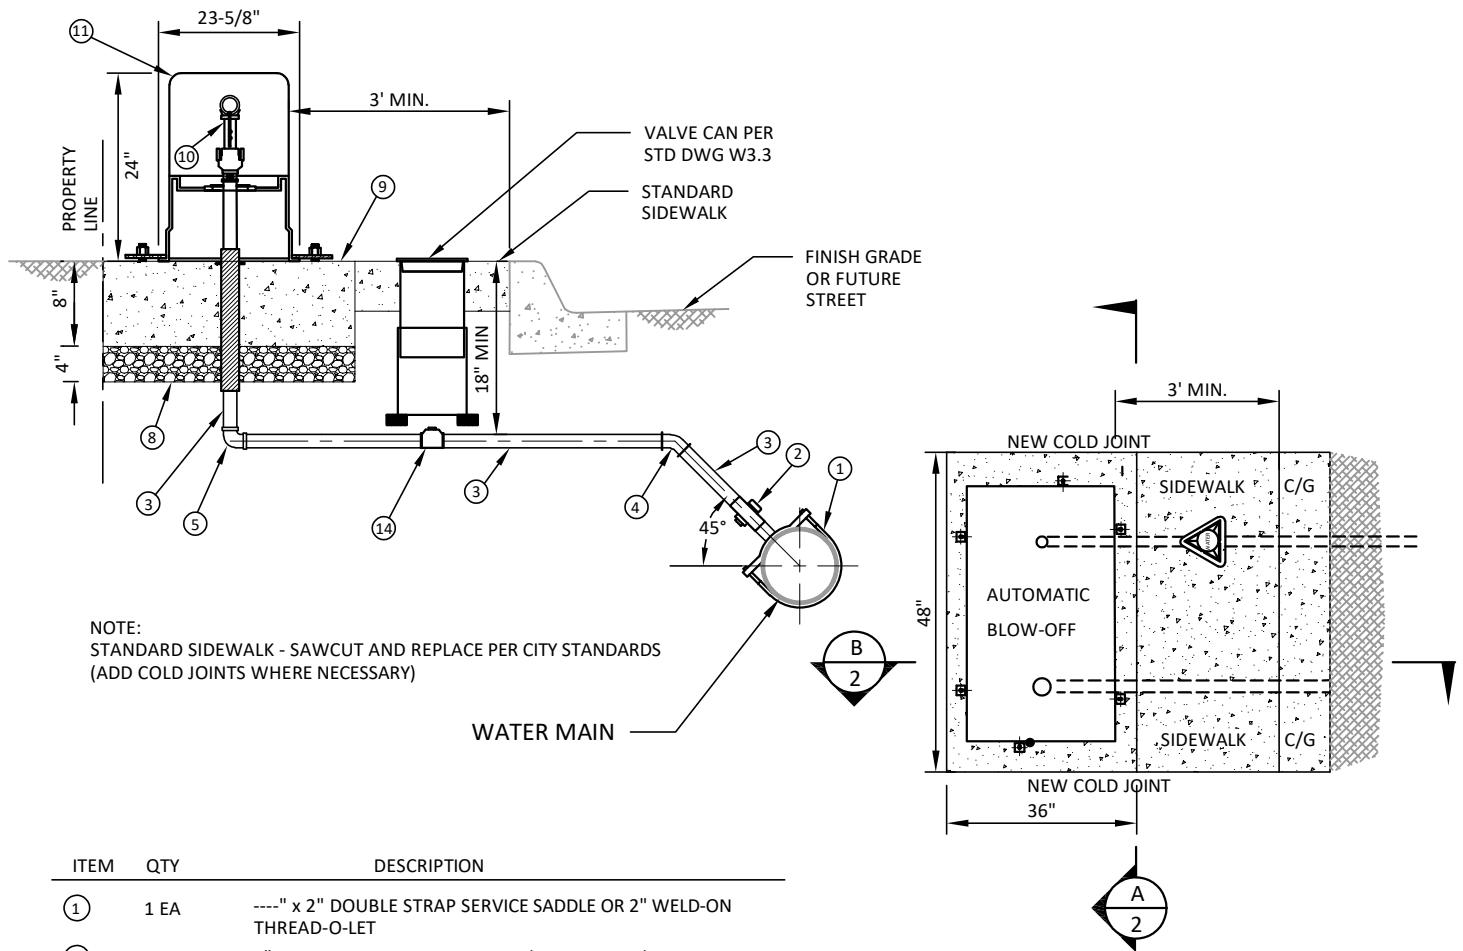

ITEM	QTY	DESCRIPTION
①	1 EA	---" x 2" DOUBLE STRAP SERVICE SADDLE OR 2" WELD-ON THREAD-O-LET
②	1 EA	2" BRONZE CORPORATION STOP (COMP. X NPT) MUELLER H15023 OR APPROVED EQUAL
③	___ L.F.	2" TYPE L HARD COPPER TUBING (SBMWD APPROVED U.S. MANUFACTURER)
④	1 EA	2" BRASS 1/8 BEND WITH TWO ADAPTERS (MIP X COMP.)
⑤	2 EA	2" BRASS COMPRESSION QUARTER BEND
⑥	—	NOT USED
⑦	16 IN.	TIGHT FITTING 3" FLEXIBLE VINYL SLEEVE OR WRAP WITH PIPE TAPE
⑧	1 EA	BASE MATERIAL
⑨	1 EA	2,000 PSI CONCRETE: 36" x 48" x 8" DEEP CONCRETE PAD (FORMED)
⑩	1 EA	2" AUTOMATIC FLUSHING VALVE ASSEMBLY (ECLIPSE MODEL 9800-WC BY KUPFERLE FOUNDRY COMPANY 1-800-231-3990) OR APPROVED EQUAL
⑪	1 EA	INSULATED FIBERGLASS ENCLOSURE, UV RESISTANT WITH LOCK LID (ECLIPSE MODEL 9800-WC)
⑫	1 EA	3" SCHEDULE 80 PVC PIPE, 90° ELBOW, AND DRAIN FUNNEL
⑬	1 EA	PERCOLATION PIT, 3' DIAMETER & 4' DEEP OR AS DIRECTED BY SBMWD ENGINEER.
⑭	1 EA	2" BALL CURB VALVE (COMP. X COMP.) MUELLER B-25209-3 OR FORD B44-777 OR JONES J-1949
⑮	1 EA	2"X6" REDUCER, ONLY TO BE USED ON CURB HEIGHTS WHERE THE 3" DRAIN WILL NOT BE APPROPRIATE.

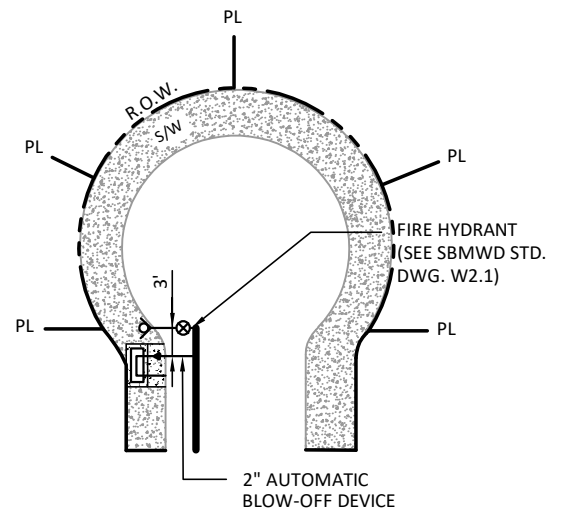

J.C.	9/21/17	SAN BERNARDINO MUNICIPAL WATER DEPARTMENT		DRAWING NUMBER
F.D.L.	MAY 14			SBMWD
F.D.L.	JUN 13	2" AUTOMATIC BLOWOFF DETAIL		W6.8
G.S.B.	JAN 11			1 OF 2
REVISION	DATE	APPROVED 		DATE 07/04/2019
SCALE:	NONE	WARREN HUANG, P.E. RCE 49208		