

VENT HOLE SPECIFICATIONS				
STANDPIPE DIA"D"	SPACING DESCRIPTION			
6"	8 ROWS OF 9 EQUALLY SPACED 1" HOLES (72 HOLES TOTAL)			
8"	8 ROWS OF 12 EQUALLY SPACED 1" HOLES (96 HOLES TOTAL)			
10"	8 ROWS OF 17 EQUALLY SPACED 1" HOLES (136 HOLES TOTAL)			
12"	8 ROWS OF 20 EOUALLY SPACED 1" HOLES (160 HOLES TOTAL)			

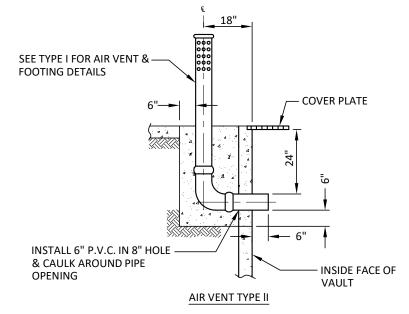

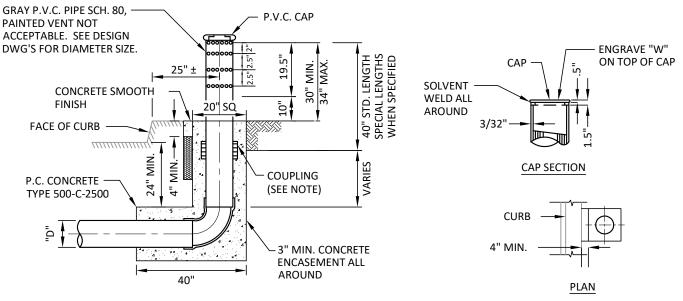

INLET OR OUTLET AIR VENT TYPE I

NOTES:

- 1. ALL JOINTS ARE TO BE SEALED AGAINST WATER INFILTRATION IN CONFORMANCE WITH CONDUIT MANUFACTURERS RECOMMENDATIONS AND ARE TO BE MADE IN THE PRESENCE OF WATER INSPECTOR (TYPE I OR II).
- 2. WHERE CURBS AND GRADES ARE NOT ESTABLISHED, BOTTOM HOLES OF VENTS MUST BE 10" MINIMUM ABOVE SURFACE OF THE GROUND (TYPE I ONLY).

REVISION DATE: 3/30/2011

		SAN BERNARDINO MUNICIPAL WATER DEPARTMENT	DRAWING NUMBER
			NOWIDER
D.D.M.	MAR. 11	AIR VENT FOR U.G. STRUCTURES	SBMWD
M.H.L.	MAR. 05	Λ.	
REVISION	DATE	A POPO VED. DATE OF 104 1000	W6.29
SCALE: NONE		APPROVED DATE 07/04/201	.9