


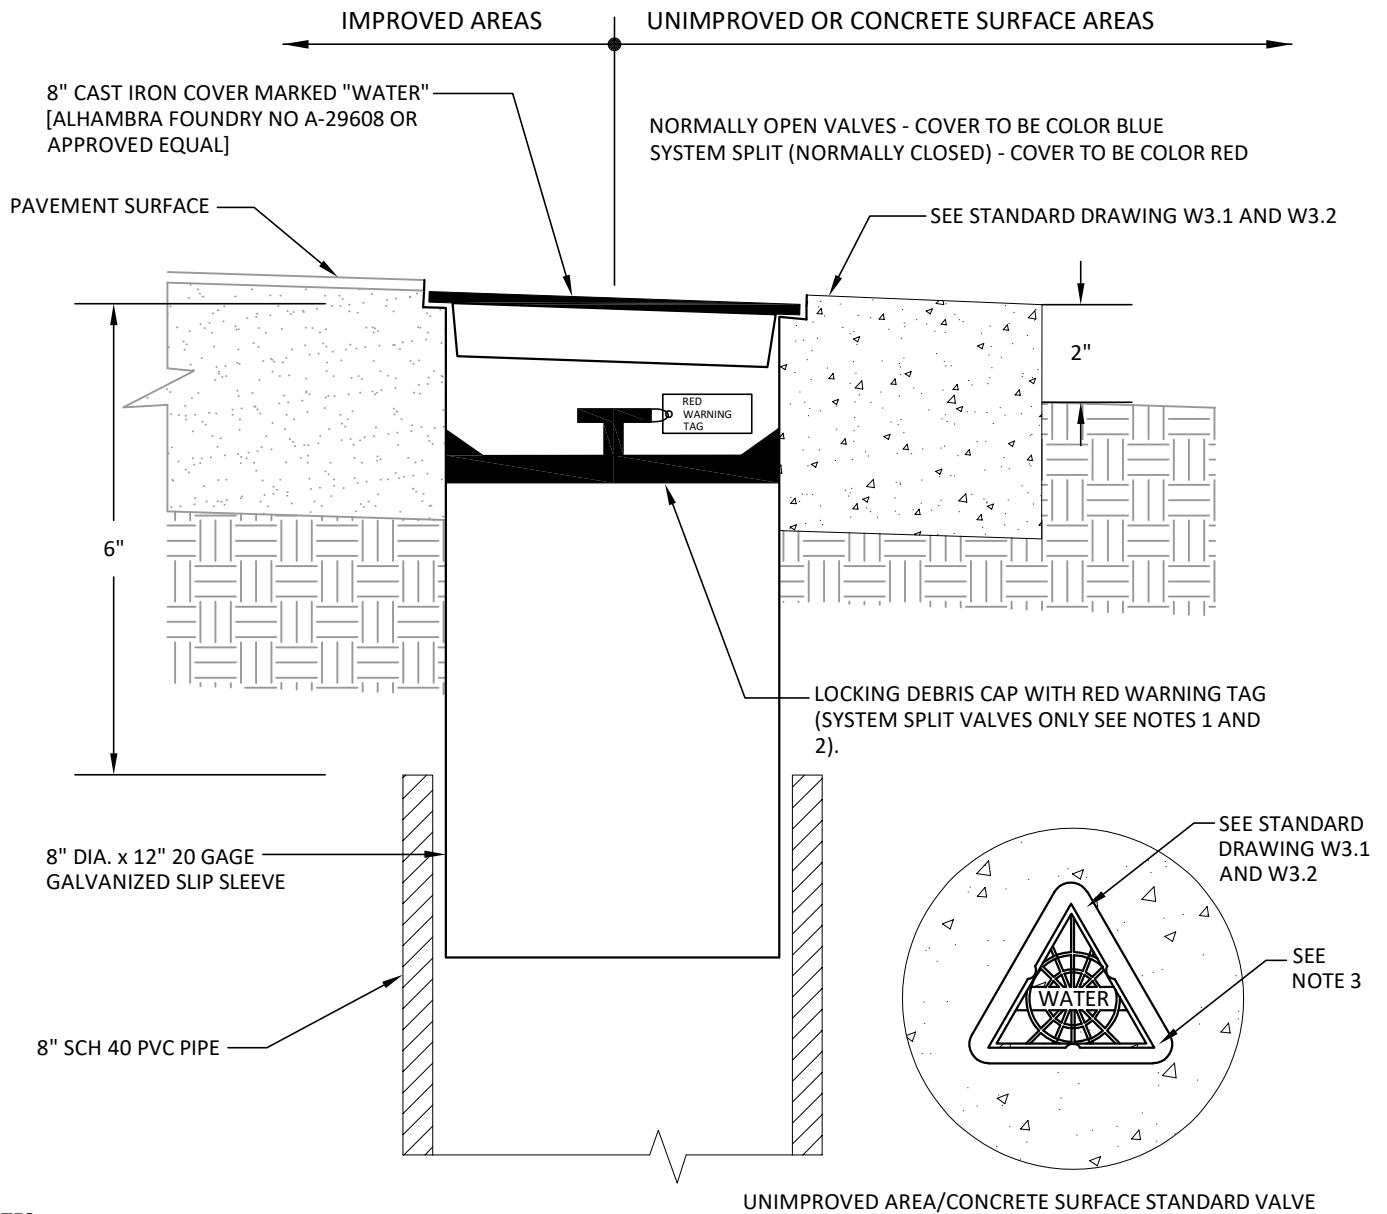

NOTES:

1. LOCKING DEBRIS CAP SHALL BE MODEL NO. LD-B BY S.W. SERVICES, PHOENIX OR APPROVED EQUAL (SYSTEM SPLIT VALVES ONLY)
2. RED WARNING TAG SHALL BE BRIGHT RED PLASTIC AND SHALL READ AS FOLLOWS (SYSTEM SPLIT VALVES ONLY):

WARNING!

○ SYSTEM SPLIT VALVE (NORMALLY CLOSED)
 VALVE TO BE OPERATED BY SBMWD PERSONNEL ONLY
 VALVE ID NO. _____
 NO. OF TURNS TO CLOSE _____

SBMWD INSPECTOR SHALL FILL-IN VALVE ID NO. AND NO. OF TURNS TO CLOSE VALVE. PLACE TAG AND DEBRIS CAP IN CAN AFTER VALVE MAINTENANCE.

3. A BROOKS TRIANGULAR CAST IRON COVER WITH A CONCRETE BASE IS REQUIRED WHERE THE VALVE IS LOCATED IN AN UNIMPROVED AREA OR AT A CONCRETE SURFACE AS REQUIRED BY THE ENGINEER.

REVISION DATE: 01/31/2014

F.D.L.	JAN. 14	SAN BERNARDINO MUNICIPAL WATER DEPARTMENT		DRAWING
F.D.L.	SEPT 12			NUMBER
F.D.L.	AUG. 12	TYPICAL VALVE CAN INSTALLATION		SBMWD
D.D.M.	JAN. 11			
REVISION	DATE			W3.3
SCALE: NONE		APPROVED	DATE 07/04/2019	
WARREN HUANG, P.E. RCE 49208				